


Leak Detection System Alarm Box (Alarms locally)
 Detects JP-8 Fuel Leakage into the Double-Wall Piping Void



Entrance Gate (Normally Locked)


Concrete Fuel Loading/Unloading Racks

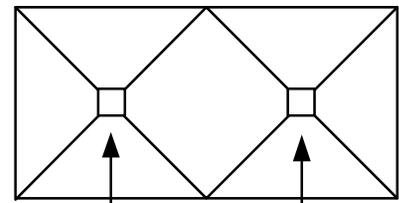

4" Curbing

Note: Loading Racks Drain to Bottom of Secondary Containment to Tank #1

Pumps/Piping for Fueling/Defueling Tanker Trucks

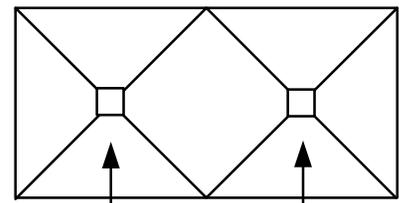

4" Curbing


Concrete Fuel Loading/Unloading Racks



Storage Building for Bulk Oil Issue

Side Gate (Normally Locked)


Buried 4" Double-Walled Piping

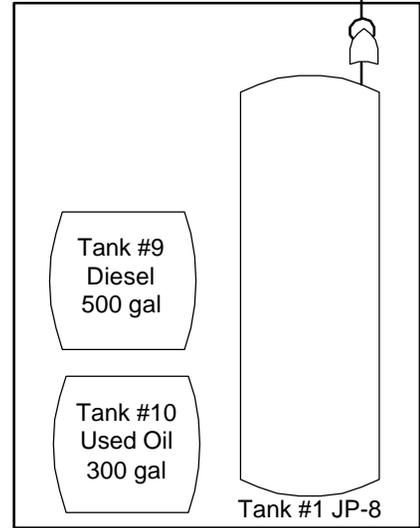

Tank #9 Diesel 500 gal

Tank #10 Used Oil 300 gal

Tank #1 JP-8

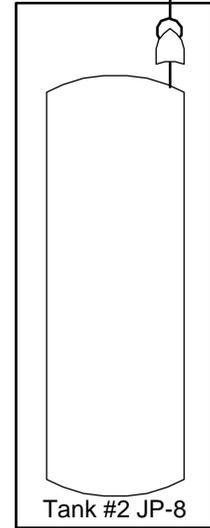

Tank #2 JP-8

Concrete Secondary Containment

Drain Valves (Drains to Drainage Ditch; Normally Locked Out)

Tank #1 and #2 are 30,000 Gallons each



Felker Army Airfield - JP-8 Fuel Terminal